



01 SITE PLAN
SCALE-1:500

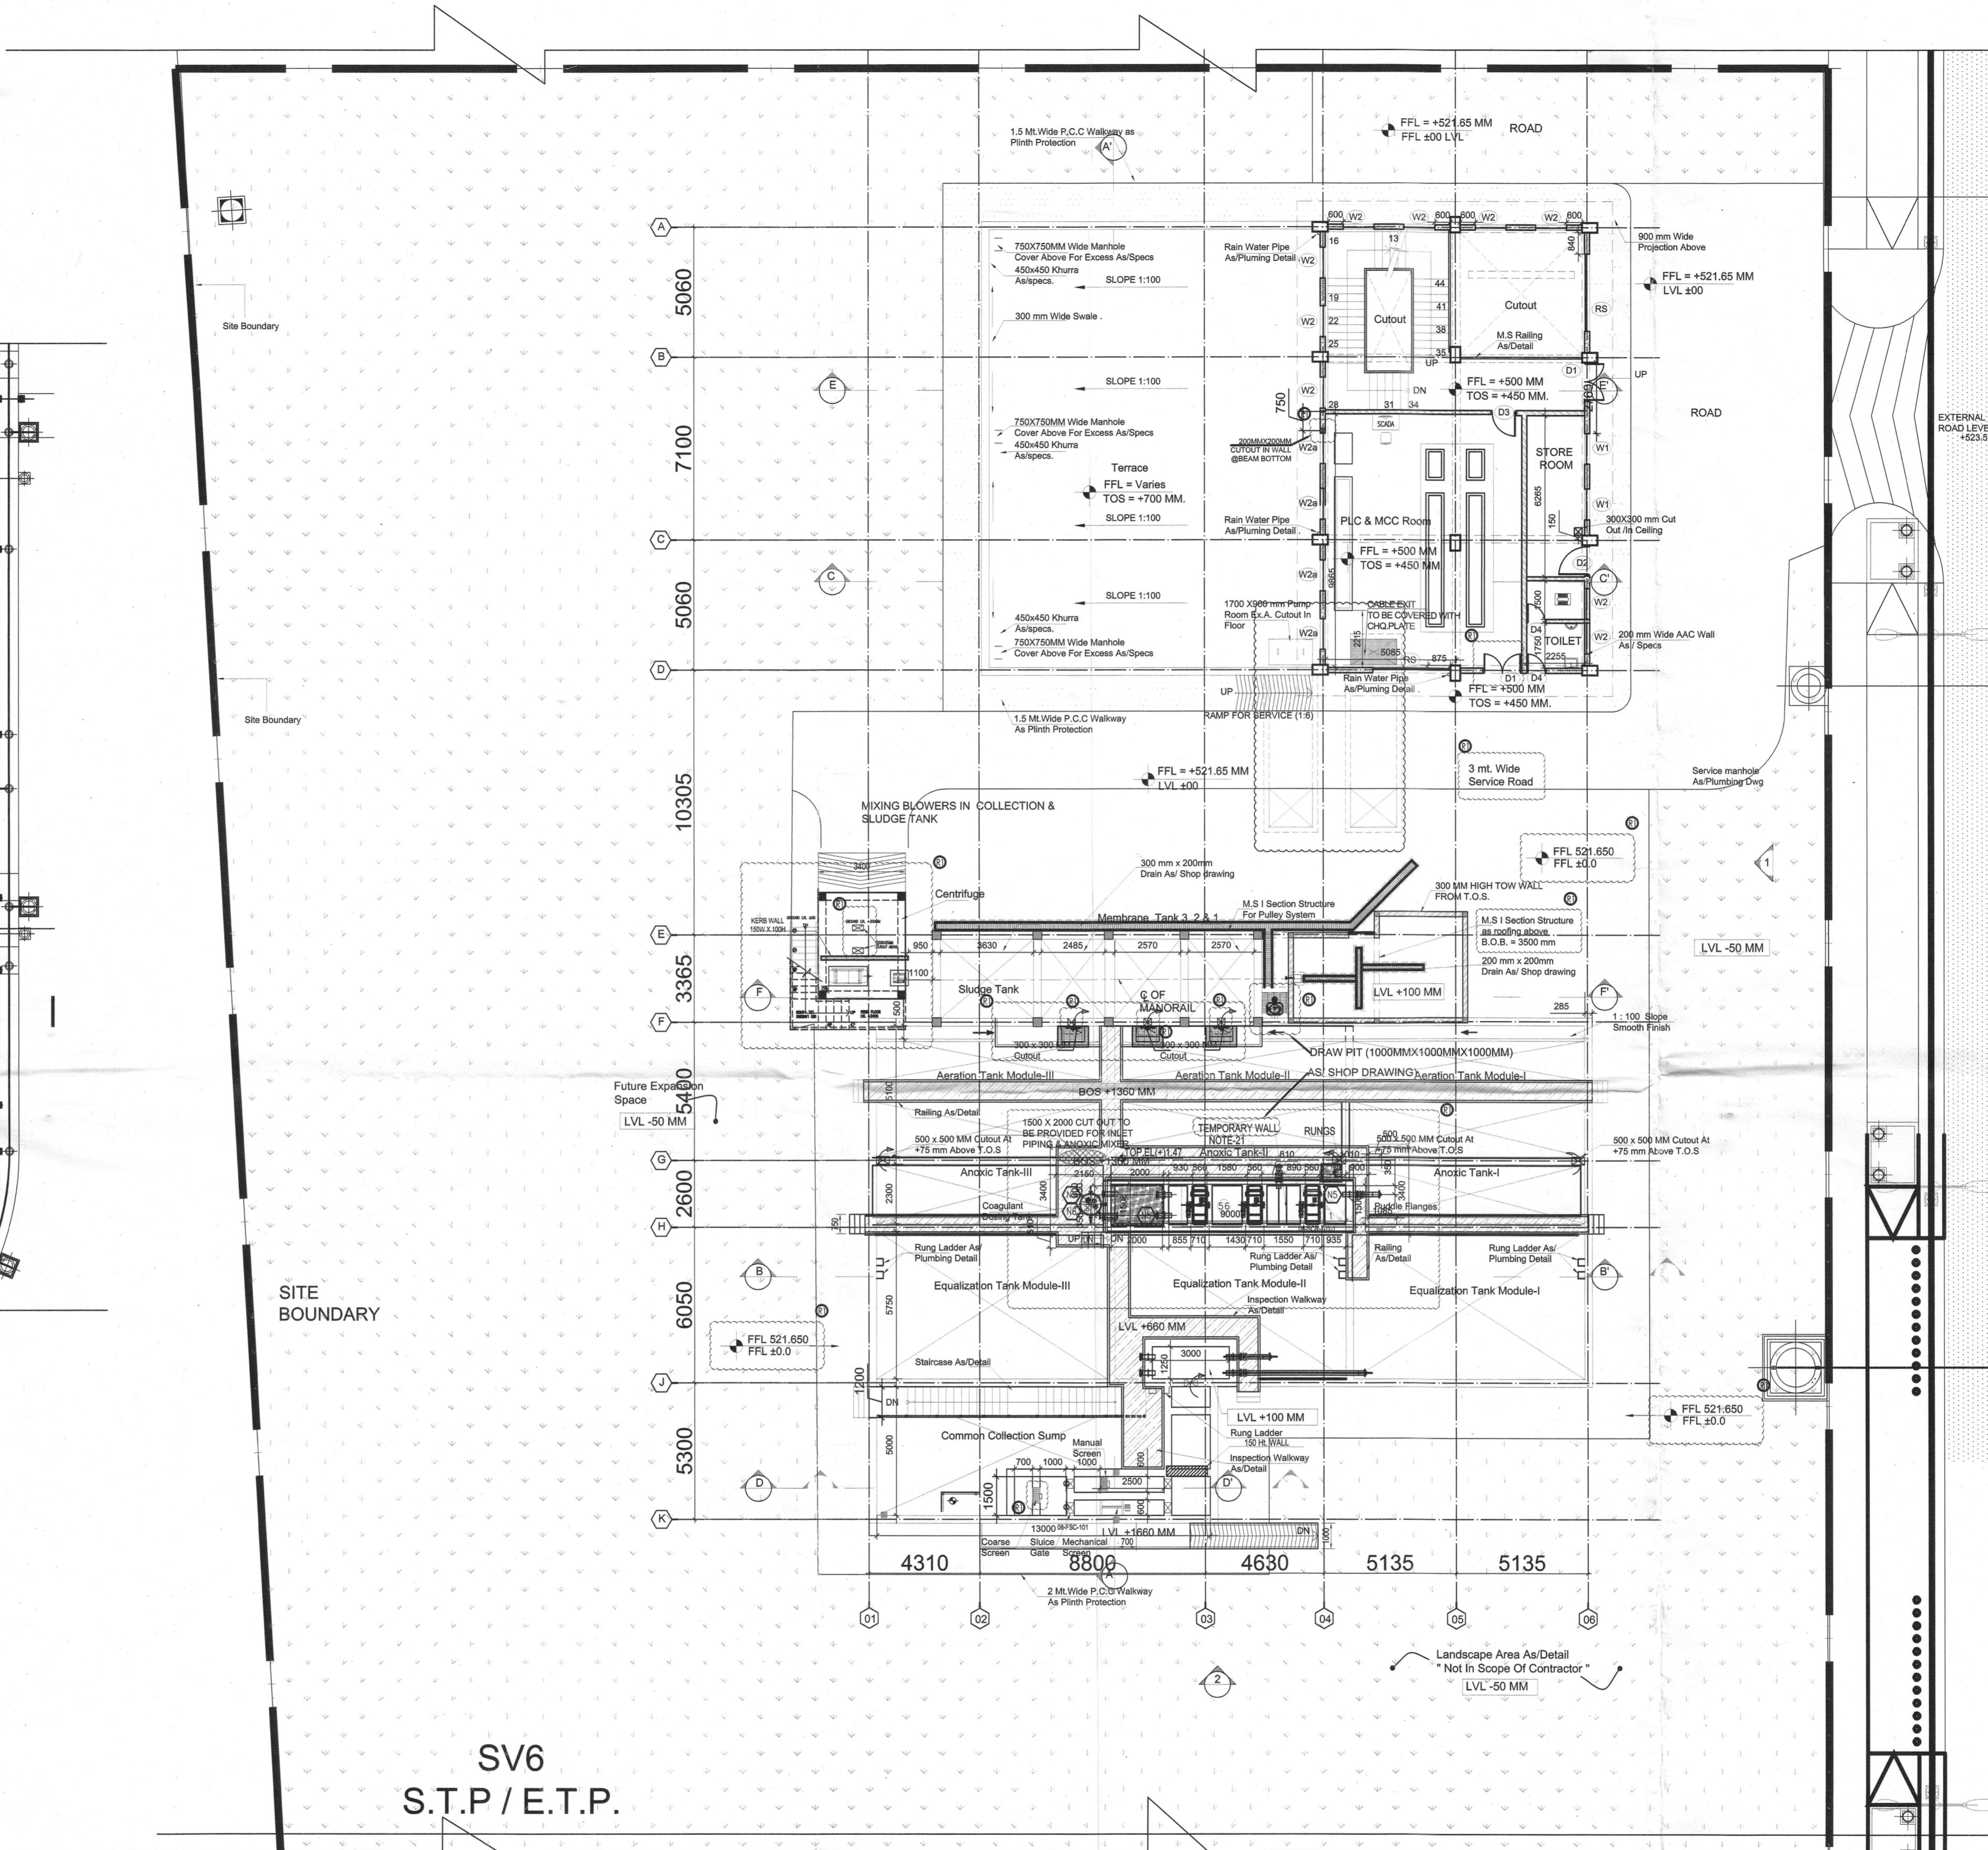

02 GROUND FLOOR PLAN
SCALE-1:150

SV6
S.T.P./E.T.P.

- NOTES**
- ALL M.S. ELEMENTS SHALL BE FINISHED WITH ZINC CHROMATE PRIMER & 2 COATS OF SYNTHETIC ENAMEL PAINT OF LOW V.C.C.
 - ALL R.C.C. MEMBERS COMING IN CONTACT WITH SEWAGE SHALL BE COATED WITH 2 COATS OF EPOXY COATING.
 - FOR VENTILATION - SUFFICIENT NOS. OF CEILING & EXHAUST FANS TO BE PROVIDED.
 - FOOT REST TO BE PROVIDED INSIDE TANK FOR MAINTENANCE PURPOSE (AS SPECS.)
 - HARDWARE FOR DOORS & WINDOWS TO BE AS SPECIFICATIONS.
 - INTERNAL FINISH:-
 - (a) FOR THE TANKS MEANT FOR SEWAGE COLLECTION = COAL TAR EPOXY.
 - (b) FOR THE TANKS MEANT FOR CLEAR WATER COLLECTION = CERAMIC TILES.

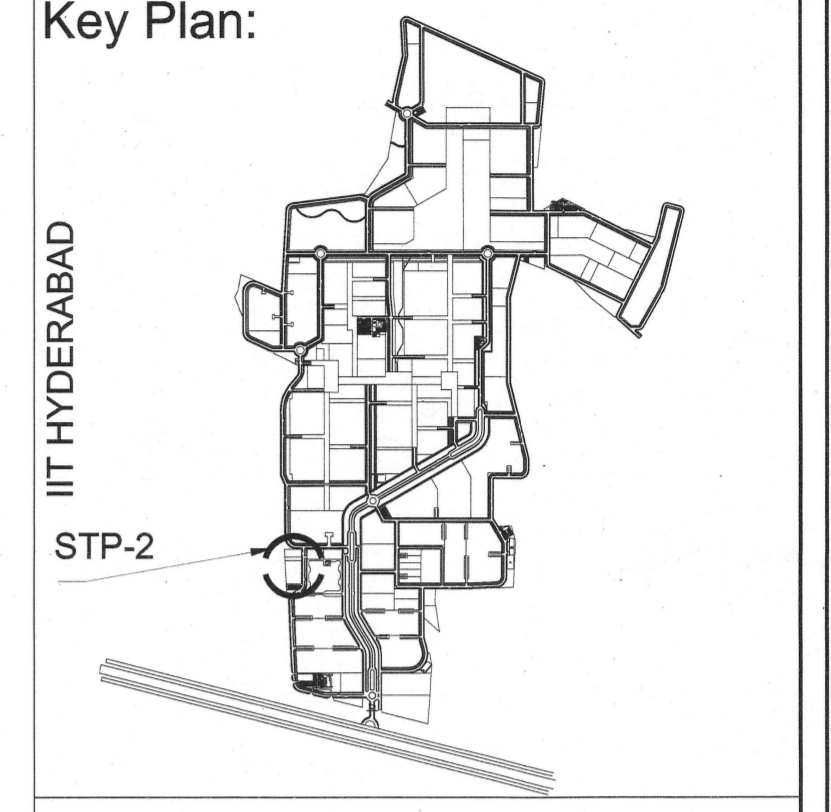

ISSUES

S. NO.	DATE	BY	TO	PURPOSE
1.	19-04-2017	ARCOP	SITE	GFC
2.	3-08-2018	ARCOP	SITE	GFC(R1)

REVISIONS

CLIENTS
Indian Institute of Technology(IIT) Hyderabad,
Ordnance Factory Estate,
Yeddumallaram-502205,
Andhra Pradesh, INDIA

ARCHITECTS & PLANNERS
ARCOP ASSOCIATES PVT. LTD.
E-106, G.K. ENCLAVE PART 1
NEW DELHI 110048
PHONE : 011 - 26242050
FAX : 011 - 26242035

Architect's Signature _____
Client's Signature _____
8 AUG 2018

Job Title
IITH EXTERNAL SERVICES BUILDINGS

Drawing Title
MBR BASED SEWER TREATMENT PLANT-2

Document Release Type
GOOD FOR CONSTRUCTION

Job No.	2012/09	N ↑
Scale	AS SPEC.	
Date	APRIL.19. 2017	Drawing No.
Drawn by	VARALIKA	STP2-AR-01
Checked by	PANKAJ	Revision No.
		R1

AUTHORITY:

S.no.	Plot no.	N.G.L	Building external finish Lvl (±00)
-1.	-	+523.65	+523.5

GOOD FOR CONSTRUCTION
03 AUG 2018
Arcop Associates Private Limited